

# Environmental Monitoring Report

---

Semestral Report  
January – June 2016  
July 2016

## Azerbaijan: Water Supply and Sanitation Investment Program – Nakhchivan City Water Supply and Sewerage Subproject (Tranches 2 and 3)

Prepared by State Amelioration and Water Management Committee for the Government of Azerbaijan and the Asian Development Bank.

## **CURRENCY EQUIVALENTS**

(As of 1 July 2016)

Currency Unit – Azerbaijan New Manat (AZN)

AZN 1.00 = USD 0.6431

USD 1.00 = AZN 1.5549

## **ACRONYMS**

ADB	:	Asian Development Bank
AR	:	Autonomous Republic
ECO	:	Environmental Control Official
EIA	:	Environmental Impact Assessment
EMP	:	Environmental Management Plan
EMU	:	Environmental Management Unit
IEE	:	Initial Environmental Examination
Km	:	Kilometer
m <sup>3</sup>	:	Cubic meter
Mg/L	:	milligrams per liter
Mld	:	Million liter per day
MENR	:	Ministry of Ecology and Natural Resources
M&E	:	Monitoring and Evaluation
NAR	:	Nakhchivan Autonomous Republic
PIU	:	Project Implementation Unit
PMF	:	Project Management Facility
PMO	:	Project Management Office
Project	:	Nakhchivan City Water Supply and Sewage Project
SAWMC	:	State Amelioration and Water Management Committee
SEE	:	The State Ecological Expertise
SNIP	:	Construction Norms and Regulations of Azerbaijan
WSS	:	Water Supply and Sewage
WTP	:	Water Treatment Plant
WWTP	:	Wastewater Treatment Plant
WHO	:	World Health Organization

This environmental monitoring report is a document of the borrower. The views expressed herein do not necessarily represent those of ADB's Board of Directors, Management, or staff, and may be preliminary in nature.

In preparing any country program or strategy, financing any project, or by making any designation of or reference to a particular territory or geographic area in this document, the Asian Development Bank does not intend to make any judgments as to the legal or other status of any territory or area

## CONTENTS

I.	INTRODUCTION .....	4
A.	Introduction to the Project .....	4
B.	Objectives of Biannual Environmental Reporting.....	5
C.	Methodology .....	5
D.	Project Organization .....	6
E.	Construction activities and Project Progress during previous 6 months.....	6
F.	Environmental Management Team.....	7
G.	Relationships with Contractors, Owner, Lender and Engineer .....	8
II.	ENVIRONMENTAL MONITORING .....	9
A.	Status .....	9
B.	Results.....	9
C.	Action .....	11
III.	ENVIRONMENTAL MANAGEMENT .....	12
A.	Status .....	12
B.	Documents.....	12
C.	Inspections and Audits.....	12
D.	Non-compliance and Corrective Actions .....	12
E.	Consultation and Complaints .....	15
	APPENDIX 1: ENVIRONMENTAL MONITORING RESULTS.....	17
	APPENDIX 2: LIST OF PARTICIPANTS AT THE PUBLIC CONSULTATION .....	<b>ERROR!</b>
	<b>BOOKMARK NOT DEFINED.</b>	

## I. INTRODUCTION

### A. Introduction to the Project

1. The Azerbaijan Water Supply and Sanitation Investment Program is being cofinanced by the Government of Azerbaijan and the Asian Development Bank through a multitranche financing facility (MFF) involving several tranches. The Tranche 1 Nakhcivan subproject of the Investment Program included partial construction of Water Supply and Sewerage (WSS) network of the City and construction of a new Water Treatment Plant (WTP). Construction Work under Tranche 1 has been completed.

2. The Tranche 2 Nakhcivan subproject of the Investment Program, which was signed on 06.06.2012, aims construction of remaining WSS network of the City; construction of WSS network of Shixhmahmud, a small town located close to the new WTP; and construction of a new Waste Water Treatment Plant (WWTP) for Nakhcivan City.

3. The Tranche 3 Nakhcivan subproject of the MFF, which was started on 28.05.2015, aims construction of WSS network of 5 periurban towns of Nakhcivan City.

4. The Asian Development Bank (ADB) assisted The State Amelioration and Water Management Committee (SAWMC) of Nakhcivan AR for the Water Supply and Sanitation Subproject- Tranche 1 through its financing under Loan 2571-AZE; Subproject-Tranche 2 through its financing under Loan 2842-AZE; and Subproject-Tranche 3 through its financing under Loan 3049-AZE . Two procurement packages exist under Loan 2571-AZE in Tranche 1, four procurement packages exist under Loan 2842-AZE in the Tranche 2, and one procurement package exists under Loan 3049-AZE in the Tranche 3:

#### - Tranche 1

Contract-1 (L-42408-ICB-2.02): Construction of 21.5 km of water network with fire fighting hydrants and house connections, 18.3 km of sewage network with manholes and house connections, and a 10,000 m<sup>3</sup> concrete water reservoir.

Contract-2 (L-42408-ICB-2.03): Construction of Nakhcivan City water treatment plant with 40,000m<sup>3</sup>/day capacity

#### - Tranche 2

Contract-3 (MFF-033-T2-ICB-1.04): Construction of 76.8 km of water network with fire fighting hydrants and house connections, 65.5 km of sewage network with manholes and house connections.

Contract-4 (MFF-033-T2-ICB-1.05): Construction of 85.7 km of water network with fire fighting hydrants and house connections, 71.0 km of sewage network with manholes and house connections.

Contract-5 (MFF-033-T2-ICB-1.06): Construction of Nakhcivan City wastewater treatment plant with 31,850m<sup>3</sup>/day average capacity.

Contract-6 (MFF-033-T2-ICB-1.07): Construction of water supply and sewage networks of Shixhmahmud town.

- **Tranche 3**

Contract-7 (MFF-043-T3-ICB-1.01): Construction of water supply and sewerage networks in periurban towns of Nakhcivan City.

5. The construction works under Contract-1, Contract-2, Contract-3 and Contract-4 were successfully completed in September 2011, May 2013, October 2013 and January 2015, respectively. The Contract 5, which was signed on 5th of June 2014, is ongoing with a completion rate of 70.58 %. The Contract 6, which was signed on 30 November 2015, is ongoing with a completion rate of 57.02 %. The Contract 7 was signed on 30 November 2015 is ongoing with a completion rate of 94.11 %. This Report (Bi-Annual Environmental Monitoring Report) is prepared for the time period from 01 January 2016 to 30 June 2016.

## **B. Objectives of Biannual Environmental Reporting**

6. The purpose of the Biannual Environmental Monitoring Reports is to provide a summary of the key issues relating to environmental management over the past six months. The summary includes an update on overall project progress, the status of SSEMP implementation, any progress made with environmental management, environmental monitoring results, and other relevant issues such as non-compliance and corrective actions, and monitoring of the Grievance Redress Mechanism (GRM).

7. The Reports are prepared by SAWMC and are intended to inform ADB and any other interested parties of the status of environmental management of the project. The Reports are summaries; more detailed information is included in the monthly and quarterly reports prepared by the Contractors and the Engineer.

## **C. Methodology**

8. The Biannual Environmental Monitoring Reports are prepared by reviewing and extracting key information from a number of sources, as follows:

- Contractors' Monthly Environmental Management Reports;
- Engineer's Quarterly Progress Reports;
- PIU Environmental Specialist's Field Reports;
- Monthly instrumented monitoring results; and
- Correspondence between SAWMC, Engineer and Contractors relating to environmental and social issues.

9. In addition, some information and opinion in the reports results from site visits, technical meetings and public interviews over the preceding six months.

#### **D. Project Organization**

10. Project organization for the awarded contracts under MFF listed above is given in the table below.

<b>Contract</b>	<b>Employer</b>	<b>Contractor</b>	<b>Engineer</b>	<b>Phase</b>
Contract-1 (L-42408-ICB-2.02)	SAWMC	Gemiqaya Shirketi LLC	Yolsu Engineering Services Ltd.	%100 Completed
Contract-2 (L-42408-ICB-2.03)		Gemiqaya Shirketi LLC & Denizsu Joint Ven.		%100 Completed
Contract-3 (MFF-033-T2-ICB-1.04)		Gemiqaya Shirketi LLC		%100 Completed
Contract-4 (MFF-033-T2-ICB-1.05)		Gemiqaya Shirketi LLC		%100 Completed
Contract-5 (MFF-033-T2-ICB-1.06)		Dizayn İnshaat & Bioworks JV.		Ongoing ( % 70.58 completed)
Contract-6 (MFF-033-T2-ICB-1.07)		Cahan İnshaat Llc		Ongoing ( % 57.02 completed).
Contract-7 (MFF-043-T3-ICB-1.01)		Dizayn İnshaat Llc		Ongoing ( % 94.11 completed)

#### **E. Construction activities and Project Progress during previous 6 months**

11. The construction activities continued in this period, only under Contract 5. Table 1 below shows the Contractors's monthly progress throughout the current reporting period. The civil works within this period comprised mainly construction of water basins and other structures of the WWTP, including administration building, blower room, pump rooms, sludge dewatering structure, MBR building and transformer&generator building. Also most of the yard piping was installed in place. Mechanical installation works were also started.

**Table 1:** Monthly Progress of the Contractor during the last six months

<b>Month</b>	<b>Contract-5 Cumulative Progress (%)</b>	<b>Contract-6 Cumulative Progress (%)</b>	<b>Contract-7 Cumulative Progress (%)</b>
January 2016	40.00	1.70	3.66
February 2016	46.12	7.93	16.01
March 2016	53.12	13.54	40.80
April 2016	58.34	22.62	63.62
May 2016	64.26	37.88	81.41
June 2016	70.58	57.02	94.11

12. The construction activities affecting the environment were as follows:

- (1) Trenching and excavation,
- (2) Removal of soil
- (3) Pipe installation
- (4) Backfilling and compaction
- (5) Concrete works, including rebar and formwork works.

13. The following items were monitored during the implementation of the project.

- (1) Noise
- (2) Water Quality
- (3) Air Quality
- (4) Flora - Fauna
- (5) Waste disposal

14. The subproject construction site of Contract 5 is government property, allocated to be the WWTP area. There is no protected areas, wetlands, mangroves, or estuaries. There is no land acquisition and relocation of people. Vegetation (mostly grasses), in the subproject site is those commonly found in the area. The geological structure of the area is stable, the plant site is flat, and no potential land subsidence is foreseen.

#### **F. Environmental Management Team**

15. An environmental control official (ECO) exists under the PIU of SAWMC: Mr. Orxan Seferov. The consultant has a local environmental specialist, Mr. Hilal Qasimov on site for supervision and monitoring of the Environmental Management Plan, together with the ECO.

16. The Contractor's Environmental Officer is Nahid Huseynov, for Contract 5.

- 17. The Contractor's Environmental Officer is Faraj Ismayilov, for Contract 6.
- 18. The Contractor's Environmental Officer is Ali Ismayilov, for Contract 7.

**G. Relationships with Contractors, Owner, Lender and Engineer**

- 19. The relationships between Contractors, Engineer, Owner, and Lender are considered normal working relationships.
- 20. At the working level, communication with regards to environmental issues remains good.



## **II. ENVIRONMENTAL MONITORING**

### **A. Status**

21. Regular monthly monitoring has been carried out in accordance with the SSEMP throughout the current reporting period.

22. Regular air, noise and dust measurements have been carried out by both the Contractor and the PIU ECO.

### **B. Results**

#### **a) Noise**

23. The ECO has regularly monitored the noise levels with hand held decibelmeters, both from a distance of 5m from the noise source and from the nearest residential and/or industrial area. The measured noise levels were found to be far below the maximum allowable noise levels provided in the IEE and SSEMP (i.e. 50 db for industrial areas and 40 db for residential areas). The full results are provided in Appendix 1.

24. The Contractor employed practical means to minimize noise resulting from construction work. Noise was minimized through proper maintenance of equipment and vehicles.

25. All construction tasks were carried out during unrestricted hours (09.00 to 18.00) Monday to Saturday, excluding general holidays

26. Heavy vehicles used for the purpose of the Works were required to be equipped with exhaust silencers. No diesel heavy construction equipment were kept running idle for more than five minutes.

27. Machines in intermittent use were being shut down in the intervening period between works or throttled down to a minimum.

28. The Contractor had organized his operations at the start of the project with regard to the positioning of plant and movement of vehicles to minimize noise adjacent to properties. This organization is planned to continue until the end of the project.

29. Special consideration have been provided to protect workers from harmful and long exposures to noise originating from construction machinery such as the wearing of earmuffs for operators.

30. Handling of construction materials were done during daytime.

#### b) Water Quality

31. No construction work took place around natural bodies of water like rivers, streams, etc. The nearest water body in the region is Araz River, which is approximately 1.5 km south of the project site. Araz river is a very large water body and its water quality is largely dependent on the upstream water quality. No water samplings were needed to be taken at the Araz River, since it is impossible to monitor or identify any effects of the construction on the Araz River.

32. There are few drainage ditches around the project site. These ditches are, in general, empty. Only, in heavy rain events, or during irrigation of nearby farms, excess run-off water may flow to the ditches. Daily visual inspections and monitorings of these ditches were performed. From the inspections, no issues were reported during this six months period.

33. All works have been undertaken in a manner that no debris, slash, wood chips, organic debris, soil, petroleum, diesel fuel, oil, grease, ashes, or other substances deleterious to environment was allowed to enter any water bodies. Solid Construction material and spoil stockpiles were covered to reduce material loss and run-off.

#### c) Air Quality

34. All air quality monitoring results for all determinants and all monitoring stations were below Azeri national standards during the present reporting period. Particulate, NO<sub>2</sub> and CO readings were taken regularly at the project site. The full results are provided in Appendix 1. In dry and windy days where spreading of dust may occur; the ground surfaces were sprayed with water using water trucks equipped with sprinklers or any other appropriate means.

35. 30 km/h speed limit was set for movement of heavy construction vehicles on access roads. All excavation works, and loading/unloading operations were stopped when wind speed exceeded 12 km/s.

36. There are no concrete plants at the site. Ready mix concrete was delivered with trucks from the nearest concrete plants in Nakhcivan. Hence no dust issues were observed at the WWTP site. All construction activities were executed in such a way that will minimize if not totally eliminate the spreading of dust or any inconvenience and nuisance to nearby communities.

d) Flora and Fauna

37. The Contractor did not encounter any Flora or Fauna at the construction sites, there is no Flora during the execution of the Works.

e) Waste Disposal

38. All solid wastes were properly packaged, and disposed at the designated waste disposal site of the City. The site was designated by MENR, and was located 8 km north-west of the City. Waste containers were placed in every construction site and worker camps. These containers were daily collected and disposed lawfully.

**C. Action**

39. No action is required on ongoing Contractor in response to the monitoring results from the present reporting period.

### **III. ENVIRONMENTAL MANAGEMENT**

#### **A. Status**

40. Environmental management of the project has continued to be of an acceptable standard during the present reporting period. General cleanliness of the project site is good, and the physical mitigation measures set out in the SEMP are generally all constructed and functioning as designed. Activity-based mitigation measures are also being implemented.

41. There have been no accidents during the reporting period involving the public or workers.

#### **B. Documents**

42. The Contractor submitted monthly statements to the PIU describing their environmental monitoring and management activities. Reporting was generally compliant. All relevant paperwork, including SEMP and the Grievance Register, was present at the site office, at the time of site visits performed by the ECO.

#### **C. Inspections and Audits**

43. The ADB's environmental specialists as well as the project team have visited the site numerous times in the past six months. During the visit in August, the SEMP was found to be missing in the Contractors site office. Necessary actions were taken immediately.

44. In the other site visits of the ADB team in this reporting period, no non-compliances were observed.

45. PIU Environmental Control Official performed daily site visits to the project site. In addition, the consultants' local environmental specialist were on site daily to monitor safeguard measures and to take actions when needed.

#### **D. Non-compliance and Corrective Actions**

46. The Contractor has continued the construction works on site over the past six months within the bounds of the SEMP; all works were compliant, and the site was clean, tidy, and well maintained. General view of the project site is shown in Figure 1 below.



**Figure 1: General Views of the site**

47. Dust control in general was observed to be appropriate, with trucks frequently observed at the project site; examples are shown in Figure 2 below.





**Figure 2: Dust Control at Project site**


48. Air quality and noise monitorings were done frequently on the project site. Below are few examples of monitoring works.



**Figure 3: Noise and Dust Measurement Equipment at Project site**

49. Stocking of materials and equipment was found to be appropriate. Below are few examples of stocked pipes and equipment on site.



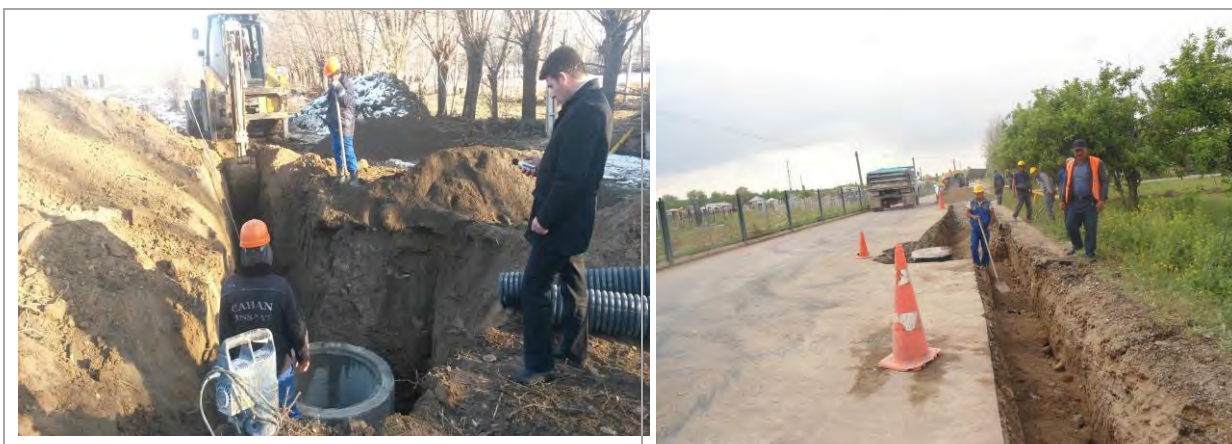

**Figure 4: Noise and Dust Measurement Equipment at Pipeline construction on site**

## **E. Consultation and Complaints**

50. Environmental management of the project has continued to be of an acceptable standard during the present reporting period. General cleanliness of the project site is good, and the physical mitigation measures set out in the SSEMP are generally all constructed and functioning as designed. Activity-based mitigation measures are also being implemented.

51. During the present reporting period a public consultation was held on the following date at the Contractor Camp. The Executive Authority and the Engineer also attended the meeting.

## **F. Emerging Issues**

52. No emerging issues were reported during the report period.

## **G. Conclusions**

53. Environmental management of the project has continued to be of an acceptable standard during the present reporting period. General cleanliness of the project site is good, and the physical mitigation measures set out in the SSEMP are generally all constructed and functioning as designed. Activity-based mitigation measures are also being implemented.

54. No complaints were received during the report period. Although the overall work has not progressed as per the project schedule, mostly due to the delays in the arrival of mechanical equipment from Europe, the Contractor have completed most of the civil works as planned. The mechanical installation works are also progressing in fast track to match the revised project schedule.

55. Document-level compliance and level of public consultations was assessed as good within present reporting period. Contractor tries to follow SSEMP requirements. Contractos's reports were also in an acceptable level.



**APPENDIX 1: ENVIRONMENTAL MONITORING RESULTS**

## Nakhchivan Water Supply and Sanitation Investment Program

### “Construction of Nakhchivan City Wastewater Treatment Plant”

#### January 2016 - Ecological monitoring

The construction of Nakhchivan City Wastewater Treatment Plant has continued from 04.01.2016 to 29.01.2016. Ecological standards compliance was checked in the monitoring areas, workers were instructed and preventative measures were taken. The results of monitoring are in the following table:

Item	Indicator	Period	Active level	Measures undertaken	Responsibility
Environment air	Dust	Continuous	General observation	The area was watered during dry weather	Environmental Supervision Management (ESM)engineer, contractor
Volume	Volume level	Rates per hour	weekly inspections	Volume level was within the norms	ESM, Supervision engineer ,contractor
Waste monitoring impact	Waste segregation and storage	Monthly inspections	impact monitoring, compliance monitoring	waste was carried into special containers	ESM, Supervision engineer ,contractor
Quality of water	Quality\Pollutant concentration	Continuous	compliance with the licence requirements	Water quality was not changed	ESM, Supervision engineer ,contractor
Ecological resources	Local Fauna and Flora	Continuous	Minimum environmental impact	No impact was observed	ESM, Supervision engineer ,contractor
Surface	Land monitoring and erosion control	Continuous	Minimum environmental impact	Was compliant with the requirements	ESM, Supervision engineer ,contractor
Landscape	Temporary surface structure cleanness	Once before the completion	Minimum diffusion to the original landscape	Complying with the advised measure	ESM, Supervision engineer ,contractor

Nakhchivan city waste water treatment plant in January flowmeter excavation and concrete measures in preparation for the foundation layer of the camera work was given. Not any serious problem and disturbance case for people's normal daily life was found during the inspection. During construction works, according to sound level-meter the sounds made by used machines has not violated the norms (72 dBA for short term). Different kinds of waste produced by the workers and vehicles in the construction area, were transported to the special waste collectors made available by the government.


SAWMC, PMU, Monitoring and Assessment specialist

Safarov. O 

Construction supervision engineer

Rzayev. T 

Contractor specialist

Huseynov. N 

**Nakhchivan Water Supply and Sanitation Investment Program**  
**“Construction of Nakhchivan City Wastewater Treatment Plant”**  
**February 2016 - Ecological monitoring**

The construction of Nakhchivan City Wastewater Treatment Plant has continued from 01.02.2016 to 29.02.2016. Ecological standards compliance was checked in the monitoring areas, workers were instructed and preventative measures were taken. The results of monitoring are in the following table:

Item	Indicator	Period	Active level	Measures undertaken	Responsibility
Environment air	Dust	Continuous	General observation	The area was watered during dry weather	Environmental Supervision Management (ESM)engineer, contractor
Volume	Volume level	Rates per hour	weekly inspections	Volume level was within the norms	ESM, Supervision engineer ,contractor
Waste monitoring impact	Waste segregation and storage	Monthly inspections	impact monitoring, compliance monitoring	waste was carried into special containers	ESM, Supervision engineer ,contractor
Quality of water	Quality\Pollutant concentration	Continuous	compliance with the licence requirements	Water quality was not changed	ESM, Supervision engineer ,contractor
Ecological resources	Local Fauna and Flora	Continuous	Minimum environmental impact	No impact was observed	ESM, Supervision engineer ,contractor
Surface	Land monitoring and erosion control	Continuous	Minimum environmental impact	Was compliant with the requirements	ESM, Supervision engineer ,contractor
Landscape	Temporary surface structure cleanliness	Once before the completion	Minimum diffusion to the original landscape	Complying with the advised measure	ESM, Supervision engineer ,contractor

Nakhchivan city waste water treatment plant in February the air blowing construction work was carried out of the concrete walls and reinforced concrete panels. Not any serious problem and disturbance case for people's normal daily life was found during the inspection. During construction works, according to sound level-meter the sounds made by used machines has not violated the norms (68 dBA for short term). Different kinds of waste produced by the workers and vehicles in the construction area, were transported to the special waste collectors made available by the government.

SAWMC, PMU, Monitoring and Assessment specialist

Safarov. O

Construction supervision engineer

Rzayev. T

Contractor specialist

Huseynov. N



### **Nakhchivan Water Supply and Sanitation Investment Program**

#### **“Construction of Nakhchivan City Wastewater Treatment Plant”**

##### **March 2016 - Ecological monitoring**

The construction of Nakhchivan City Wastewater Treatment Plant has continued from 01.03.2016 to 31.03.2016. Ecological standards compliance was checked in the monitoring areas, workers were instructed and preventative measures were taken. The results of monitoring are in the following table:

<b>Item</b>	<b>Indicator</b>	<b>Period</b>	<b>Active level</b>	<b>Measures undertaken</b>	<b>Responsibility</b>
Environment air	Dust	Continuous	General observation	The area was watered during dry weather	Environmental Supervision Management (ESM)engineer, contractor
Volume	Volume level	Rates per hour	weekly inspections	Volume level was within the norms	ESM, Supervision engineer ,contractor
Waste monitoring impact	Waste segregation and storage	Monthly inspections	impact monitoring, compliance monitoring	waste was carried into special containers	ESM, Supervision engineer ,contractor
Quality of water	Quality\Pollutant concentration	Continuous	compliance with the licence requirements	Water quality was not changed	ESM, Supervision engineer ,contractor
Ecological resources	Local Fauna and Flora	Continuous	Minimum environmental impact	No impact was observed	ESM, Supervision engineer ,contractor
Surface	Land monitoring and erosion control	Continuous	Minimum environmental impact	Was compliant with the requirements	ESM, Supervision engineer ,contractor
Landscape	Temporary surface structure cleanliness	Once before the completion	Minimum diffusion to the original landscape	Complying with the advised measure	ESM, Supervision engineer ,contractor

Nakhchivan city waste water treatment plant during the month of March, the pool of water supply, irrigation pipes, transportation and installation work. Not any serious problem and disturbance case for people's normal daily life was found during the inspection. During construction works, according to sound level-meter the sounds made by used machines has not violated the norms (61 dBA for short term). Different kinds of waste produced by the workers and vehicles in the construction area, were transported to the special waste collectors made available by the government.

SAWMC, PMU, Monitoring and Assessment specialist

Safarov. O



Construction supervision engineer

Rzayev. T



Contractor specialist

Huseynov. N



## Nakhchivan Water Supply and Sanitation Investment Program

### “Construction of Nakhchivan City Wastewater Treatment Plant”

#### April 2016 - Ecological monitoring

The construction of Nakhchivan City Wastewater Treatment Plant has continued from 01.04.2016 to 29.04.2016. Ecological standards compliance was checked in the monitoring areas, workers were instructed and preventative measures were taken. The results of monitoring are in the following table:

Item	Indicator	Period	Active level	Measures undertaken	Responsibility
Environment air	Dust	Continuous	General observation	The area was watered during dry weather	Environmental Supervision Management (ESM)engineer, contractor
Volume	Volume level	Rates per hour	weekly inspections	Volume level was within the norms	ESM, Supervision engineer ,contractor
Waste monitoring impact	Waste segregation and storage	Monthly inspections	impact monitoring, compliance monitoring	waste was carried into special containers	ESM, Supervision engineer ,contractor
Quality of water	Quality\Pollutant concentration	Continuous	compliance with the licence requirements	Water quality was not changed	ESM, Supervision engineer ,contractor
Ecological resources	Local Fauna and Flora	Continuous	Minimum environmental impact	No impact was observed	ESM, Supervision engineer ,contractor
Surface	Land monitoring and erosion control	Continuous	Minimum environmental impact	Was compliant with the requirements	ESM, Supervision engineer ,contractor
Landscape	Temporary surface structure cleanliness	Once before the completion	Minimum diffusion to the original landscape	Complying with the advised measure	ESM, Supervision engineer ,contractor



Nakhchivan city waste water treatment plant in April, closed( anaerobic) reinforcing the panels were carried out in the pool. Not any serious problem and disturbance case for people's normal daily life was found during the inspection. During construction works, according to sound level-meter the sounds made by used machines has not violated the norms (69 dBA for short term). Different kinds of waste produced by the workers and vehicles in the construction area, were transported to the special waste collectors made available by the government.


SAWMC, PMU, Monitoring and Assessment specialist

Safarov. O 

Construction supervision engineer

Rzayev. T 

Contractor specialist

Huseynov. N 

**Nakhchivan Water Supply and Sanitation Investment Program**  
**“Construction of Nakhchivan City Wastewater Treatment Plant”**  
**May 2016 - Ecological monitoring**

The construction of Nakhchivan City Wastewater Treatment Plant has continued from 02.05.2016 to 31.05.2016. Ecological standards compliance was checked in the monitoring areas, workers were instructed and preventative measures were taken. The results of monitoring are in the following table:


Item	Indicator	Period	Active level	Measures undertaken	Responsibility
Environment air	Dust	Continuous	General observation	The area was watered during dry weather	Environmental Supervision Management (ESM)engineer, contractor
Volume	Volume level	Rates per hour	weekly inspections	Volume level was within the norms	ESM, Supervision engineer ,contractor
Waste monitoring impact	Waste segregation and storage	Monthly inspections	impact monitoring, compliance monitoring	waste was carried into special containers	ESM, Supervision engineer ,contractor
Quality of water	Quality\Pollutant concentration	Continuous	compliance with the licence requirements	Water quality was not changed	ESM, Supervision engineer ,contractor
Ecological resources	Local Fauna and Flora	Continuous	Minimum environmental impact	No impact was observed	ESM, Supervision engineer ,contractor
Surface	Land monitoring and erosion control	Continuous	Minimum environmental impact	Was compliant with the requirements	ESM, Supervision engineer ,contractor
Landscape	Temporary surface structure cleanliness	Once before the completion	Minimum diffusion to the original landscape	Complying with the advised measure	ESM, Supervision engineer ,contractor

Nakhchivan city waste water treatment plant during the month of May, and electric control system and SCADA devices supply, transportation, installation work. Not any serious problem and disturbance case for people's normal daily life was found during the inspection. During construction works, according to sound level-meter the sounds made by used machines has not violated the norms (65dBA for short term). Different kinds of waste produced by the workers and vehicles in the construction area, were transported to the special waste collectors made available by the government.


SAWMC, PMU, Monitoring and Assessment specialist

Safarov. O 

Construction supervision engineer

Rzayev. T 

Contractor specialist

Huseynov. N 

**Nakhchivan Water Supply and Sanitation Investment Program**  
**“Construction of Nakhchivan City Wastewater Treatment Plant”**  
**June 2016 - Ecological monitoring**

The construction of Nakhchivan City Wastewater Treatment Plant has continued from 01.06.2016 to 30.06.2016. Ecological standards compliance was checked in the monitoring areas, workers were instructed and preventative measures were taken. The results of monitoring are in the following table:

Item	Indicator	Period	Active level	Measures undertaken	Responsibility
Environment air	Dust	Continuous	General observation	The area was watered during dry weather	Environmental Supervision Management (ESM)engineer, contractor
Volume	Volume level	Rates per hour	weekly inspections	Volume level was within the norms	ESM, Supervision engineer ,contractor
Waste monitoring impact	Waste segregation and storage	Monthly inspections	impact monitoring, compliance monitoring	waste was carried into special containers	ESM, Supervision engineer ,contractor
Quality of water	Quality\Pollutant concentration	Continuous	compliance with the licence requirements	Water quality was not changed	ESM, Supervision engineer ,contractor
Ecological resources	Local Fauna and Flora	Continuous	Minimum environmental impact	No impact was observed	ESM, Supervision engineer ,contractor
Surface	Land monitoring and erosion control	Continuous	Minimum environmental impact	Was compliant with the requirements	ESM, Supervision engineer ,contractor
Landscape	Temporary surface structure cleanliness	Once before the completion	Minimum diffusion to the original landscape	Complying with the advised measure	ESM, Supervision engineer ,contractor

Nakhchivan city waste water treatment plant in June, copper rod, lighting systems, low-voltage cables, grounding work. Not any serious problem and disturbance case for people's normal daily life was found during the inspection. During construction works, according to sound level-meter the sounds made by used machines has not violated the norms (65dBA for short term). Different kinds of waste produced by the workers and vehicles in the construction area, were transported to the special waste collectors made available by the government.

SAWMC, PMU, Monitoring and Assessment specialist

Safarov. O



Construction supervision engineer

Rzayev. T



Contractor specialist

Huseynov. N

